


QAI DESIGN F505-D-7 – SPECIFIED TECHNOLOGIES INC. (STI)

CAN/ULC S115 / ASTM E814 - WALL DESIGN

PENETRATION TYPE	RATING MINUTES					
	ASTM E814		CAN/ULC S115 (2.5 Pa)			
	F	T	F	FH	FT	FTH
2(a) Aluminum EMT	120	0	120	120	0	0
2(b) Steel Pipe	120	0	120	120	0	0
2(c) Copper Tubing	120	0	120	120	0	0
2(d) TEK Cable	120	0	120	120	0	0

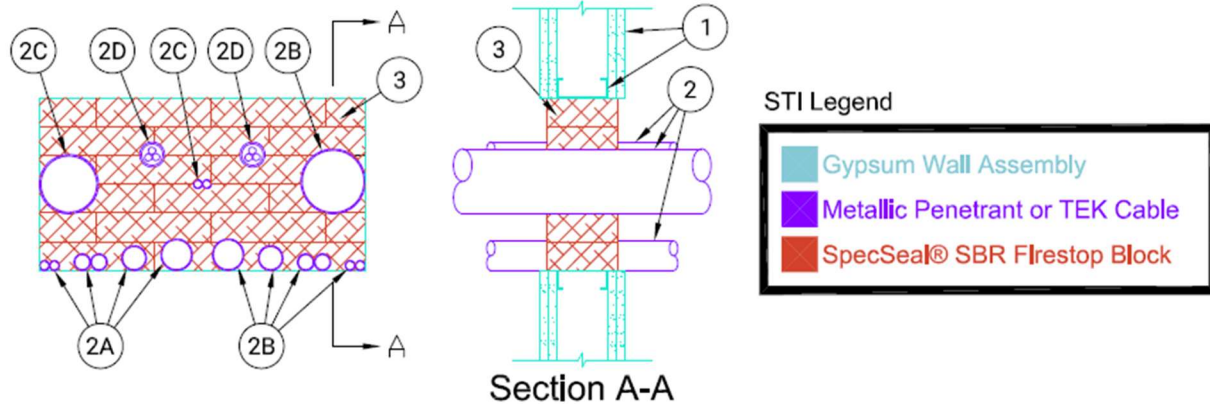

No.	COMPONENT	DESCRIPTION
1	Substrate	Type: 2 hour wood or steel stud and gypsum wall assembly designed and installed in accordance with the applicable code.
		Opening: Maximum 304 mm (12 in.) x 578 mm (22-3/4 in.)
2	Penetration	Approved Penetrations: (a) Aluminum electrical metallic tubing (EMT) – Open System (b) Steel pipe schedule 10 or heavier (c) Copper tubing Type L or heavier (d) TEK cable - Max 2/0 AWG copper conductor PVC jacketed aluminum clad or steel clad 3C.
		Penetration Size: Maximum 51 mm (2 in.) diameter (2a). Maximum 102 mm (4in.) diameter (2b). Maximum 102 mm (4in.) diameter (2c).
		Installed Annular Space: 0 mm (0 in., point contact) minimum to 260 mm (10-1/4 in.) maximum between penetrants and periphery of the opening. 0 mm (0 in.) minimum to 260 mm (10-1/4 in.) maximum between penetrants.
		Installation: Penetrants to be installed within the opening. Penetrants required to be rigidly supported on both sides of the wall assembly.
3	Firestop System	Approved Firestop: SpecSeal® SBR Firestop Block
		Installation: SpecSeal® SBR Firestop Blocks Installed with the 127 mm (5 in.) or 203 mm (8 in.) dimension of the blocks projecting through the opening and centered within the wall.

Note: Installation is to be in accordance with the above design listing, the applicable code, and the manufacturer's installation instructions for ensuring ratings noted are achieved.